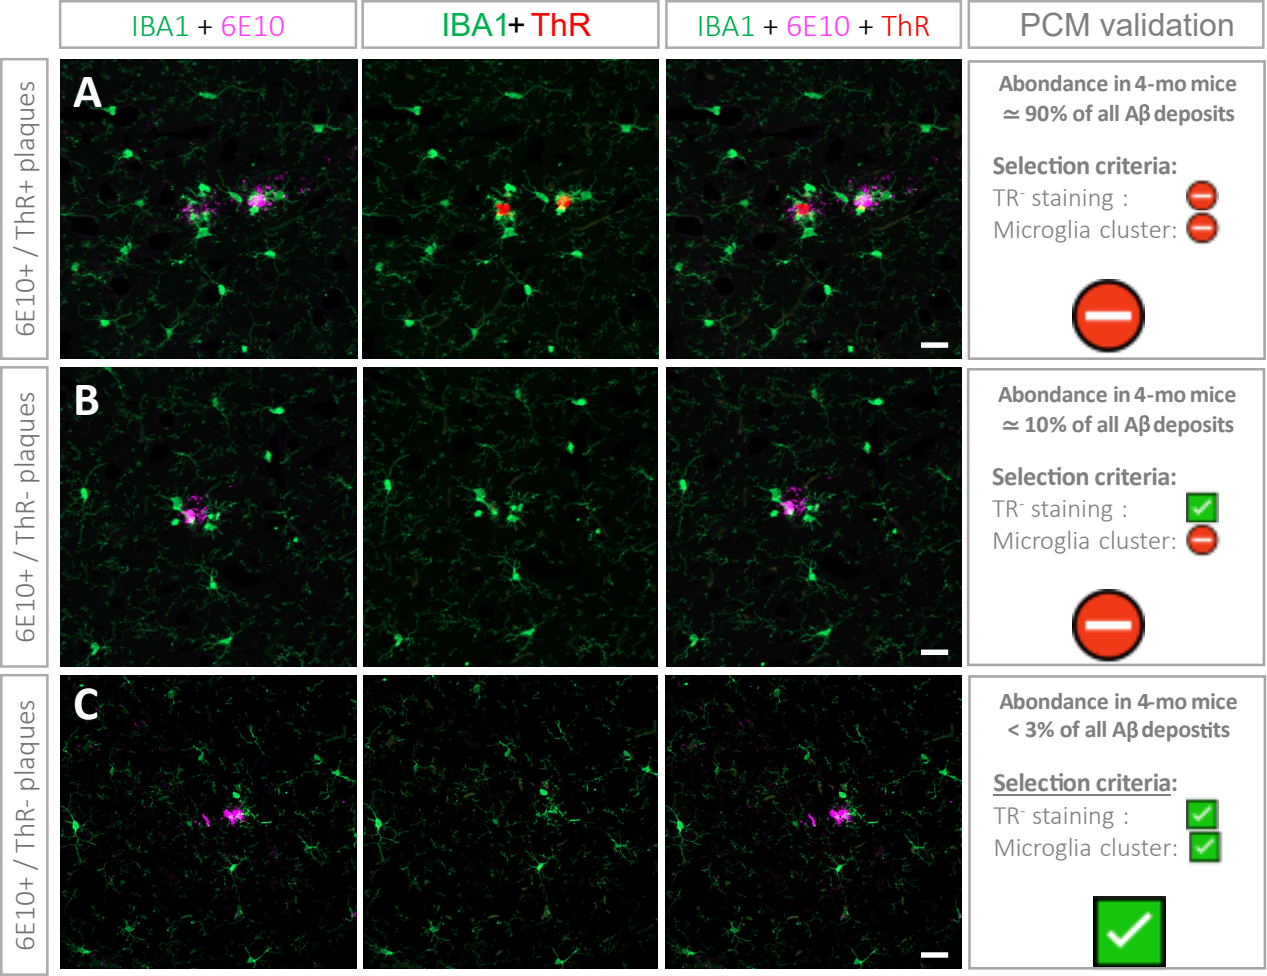
IBA1 + 6E10
IBA1+ ThR
IBA1 + 6E10 + ThR
PCM validation
6E10+ / ThR+ plaques
A
Abondance in 4-mo mice
≃ 90% of all Aβ deposits
Selection criteria:
TR- staining :
Microglia cluster:
6E10+ / ThR- plaques
B
Abondance in 4-mo mice
≃ 10% of all Aβ deposits
Selection criteria:
TR- staining :
Microglia cluster:
6E10+ / ThR- plaques
C
Abondance in 4-mo mice
< 3% of all Aβ depostits
Selection criteria:
TR- staining :
Microglia cluster: