


73 bpm
159/102 mmHg

RECUPER.
5:53

BRUCE
0.0 km/h
0.0%

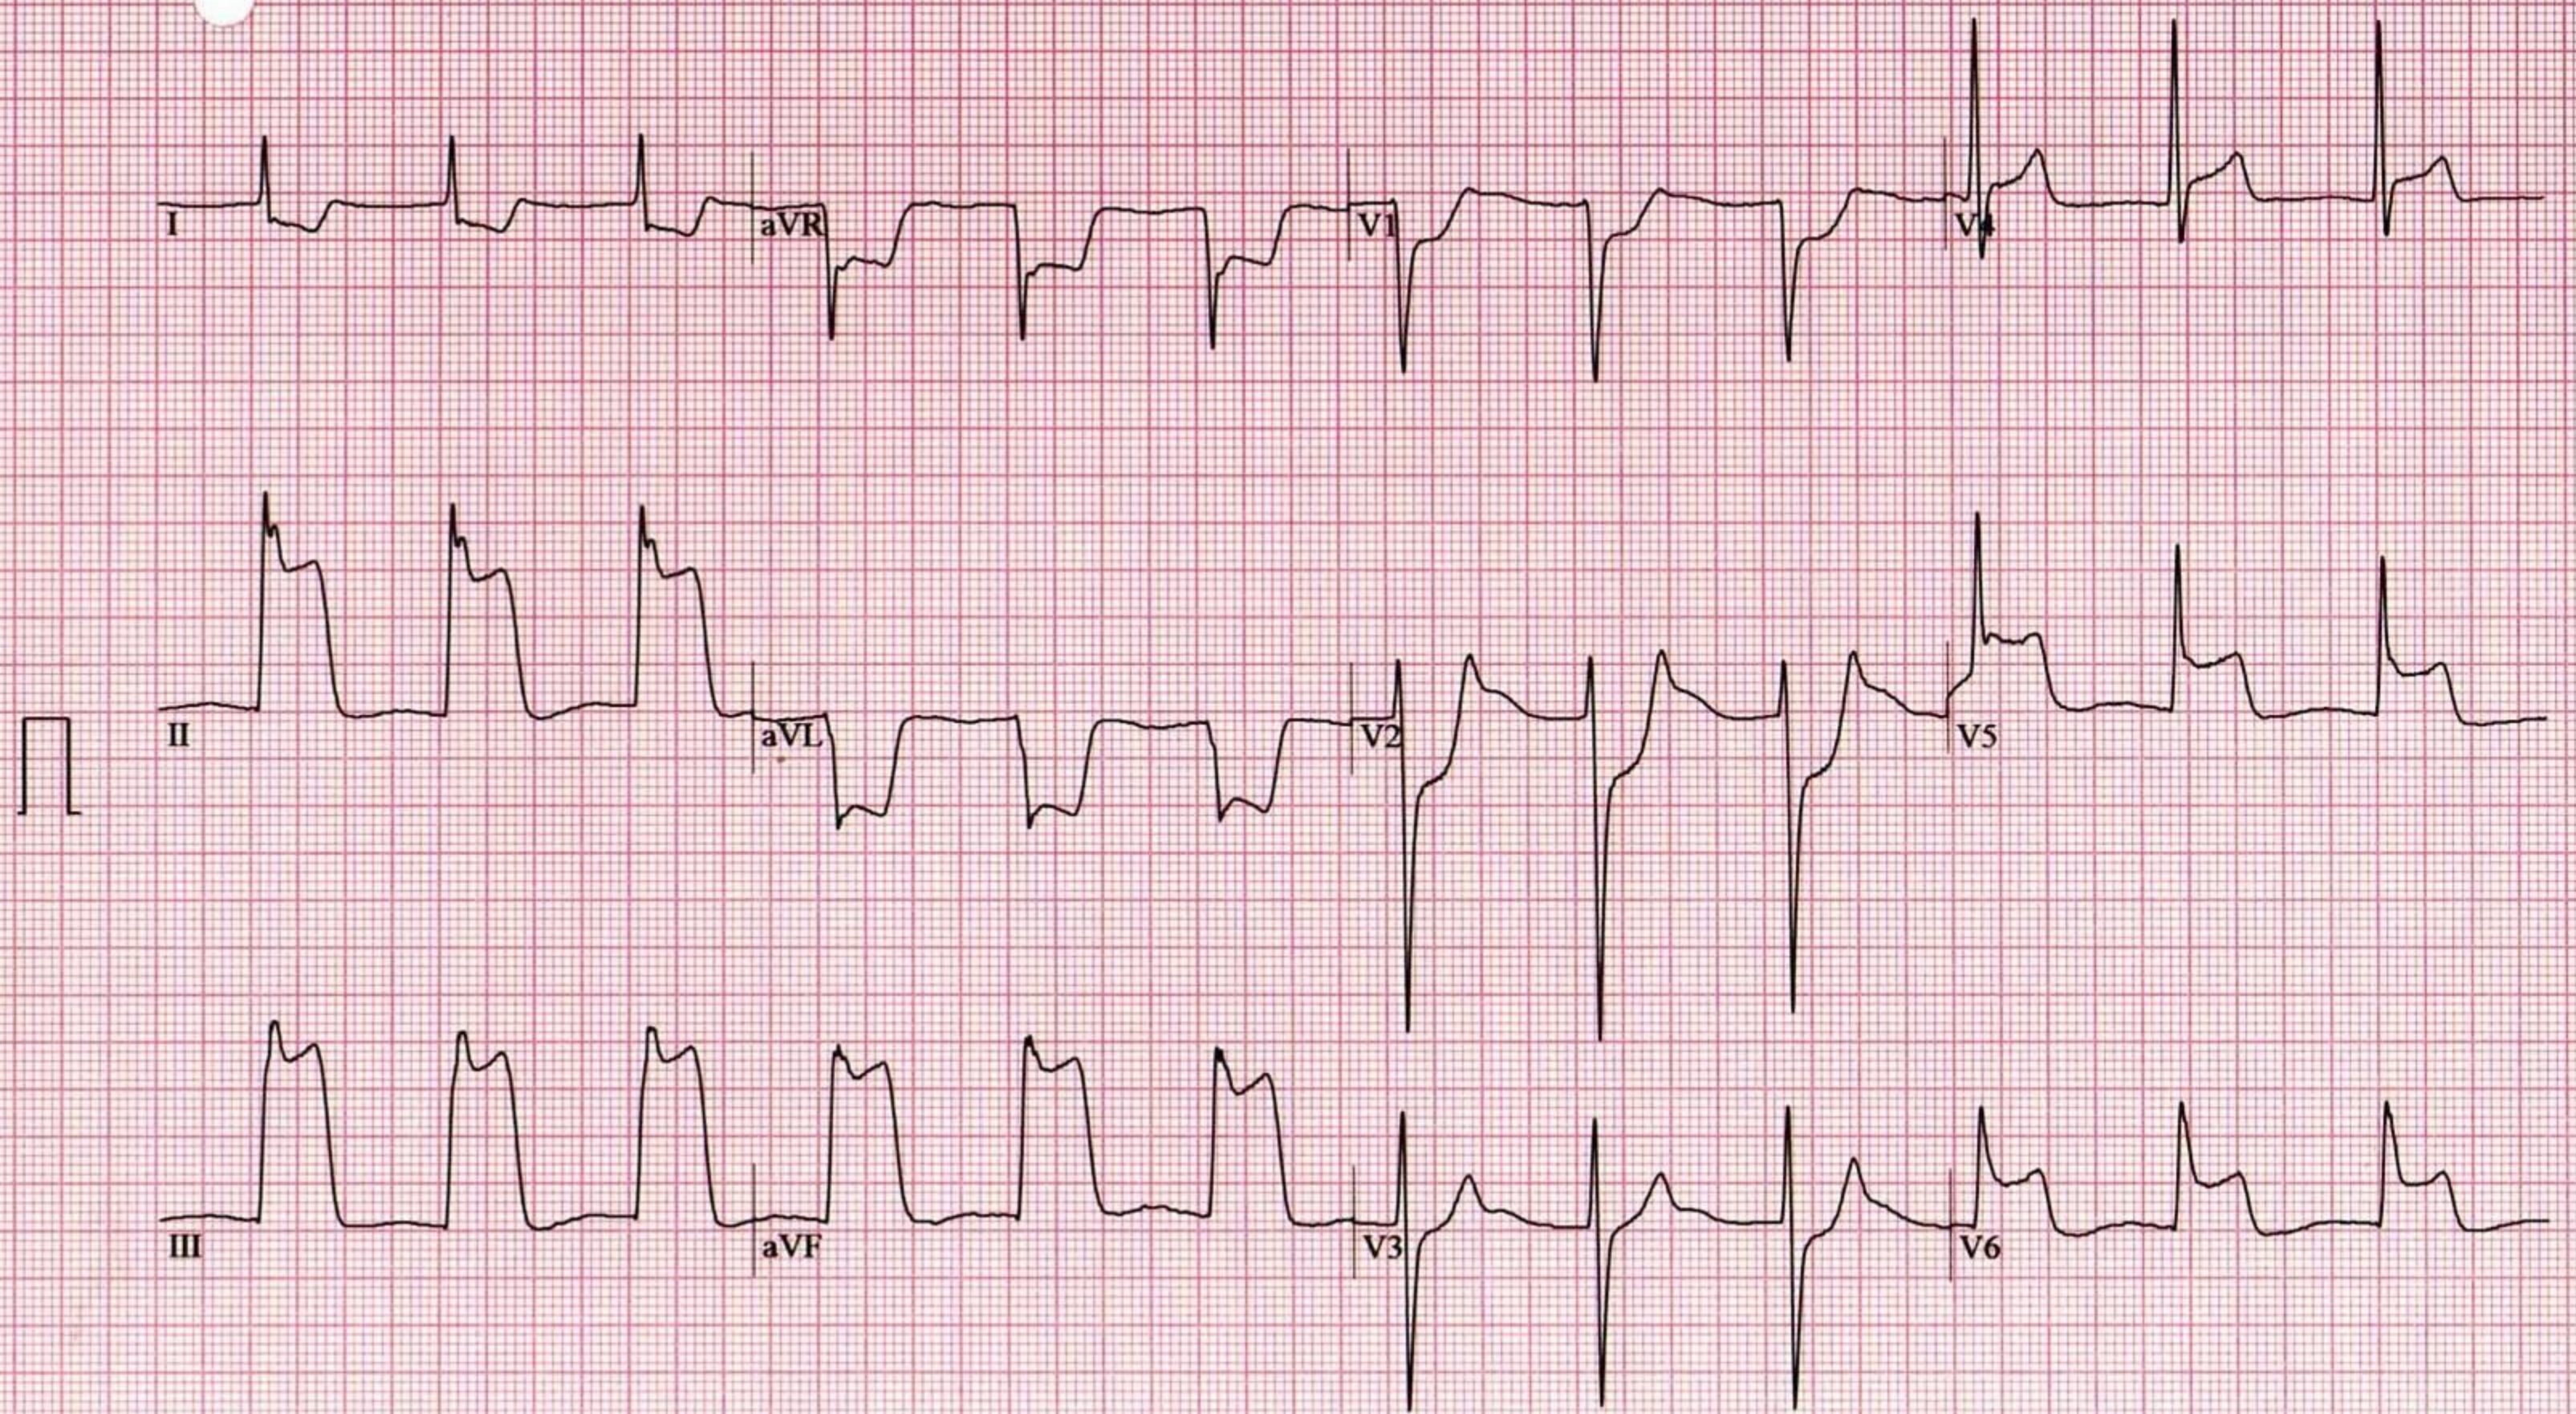

GE CASE V6.51 (0)
25mm/s 10mm/mV 50Hz 0.01Hz FRF+ FC(V1,V2)

No confirmado


Página 1

a

72 bpm
159/102 mmHg

RECUPER.
6:03

BRUCE
0.0 km/h
0.0%

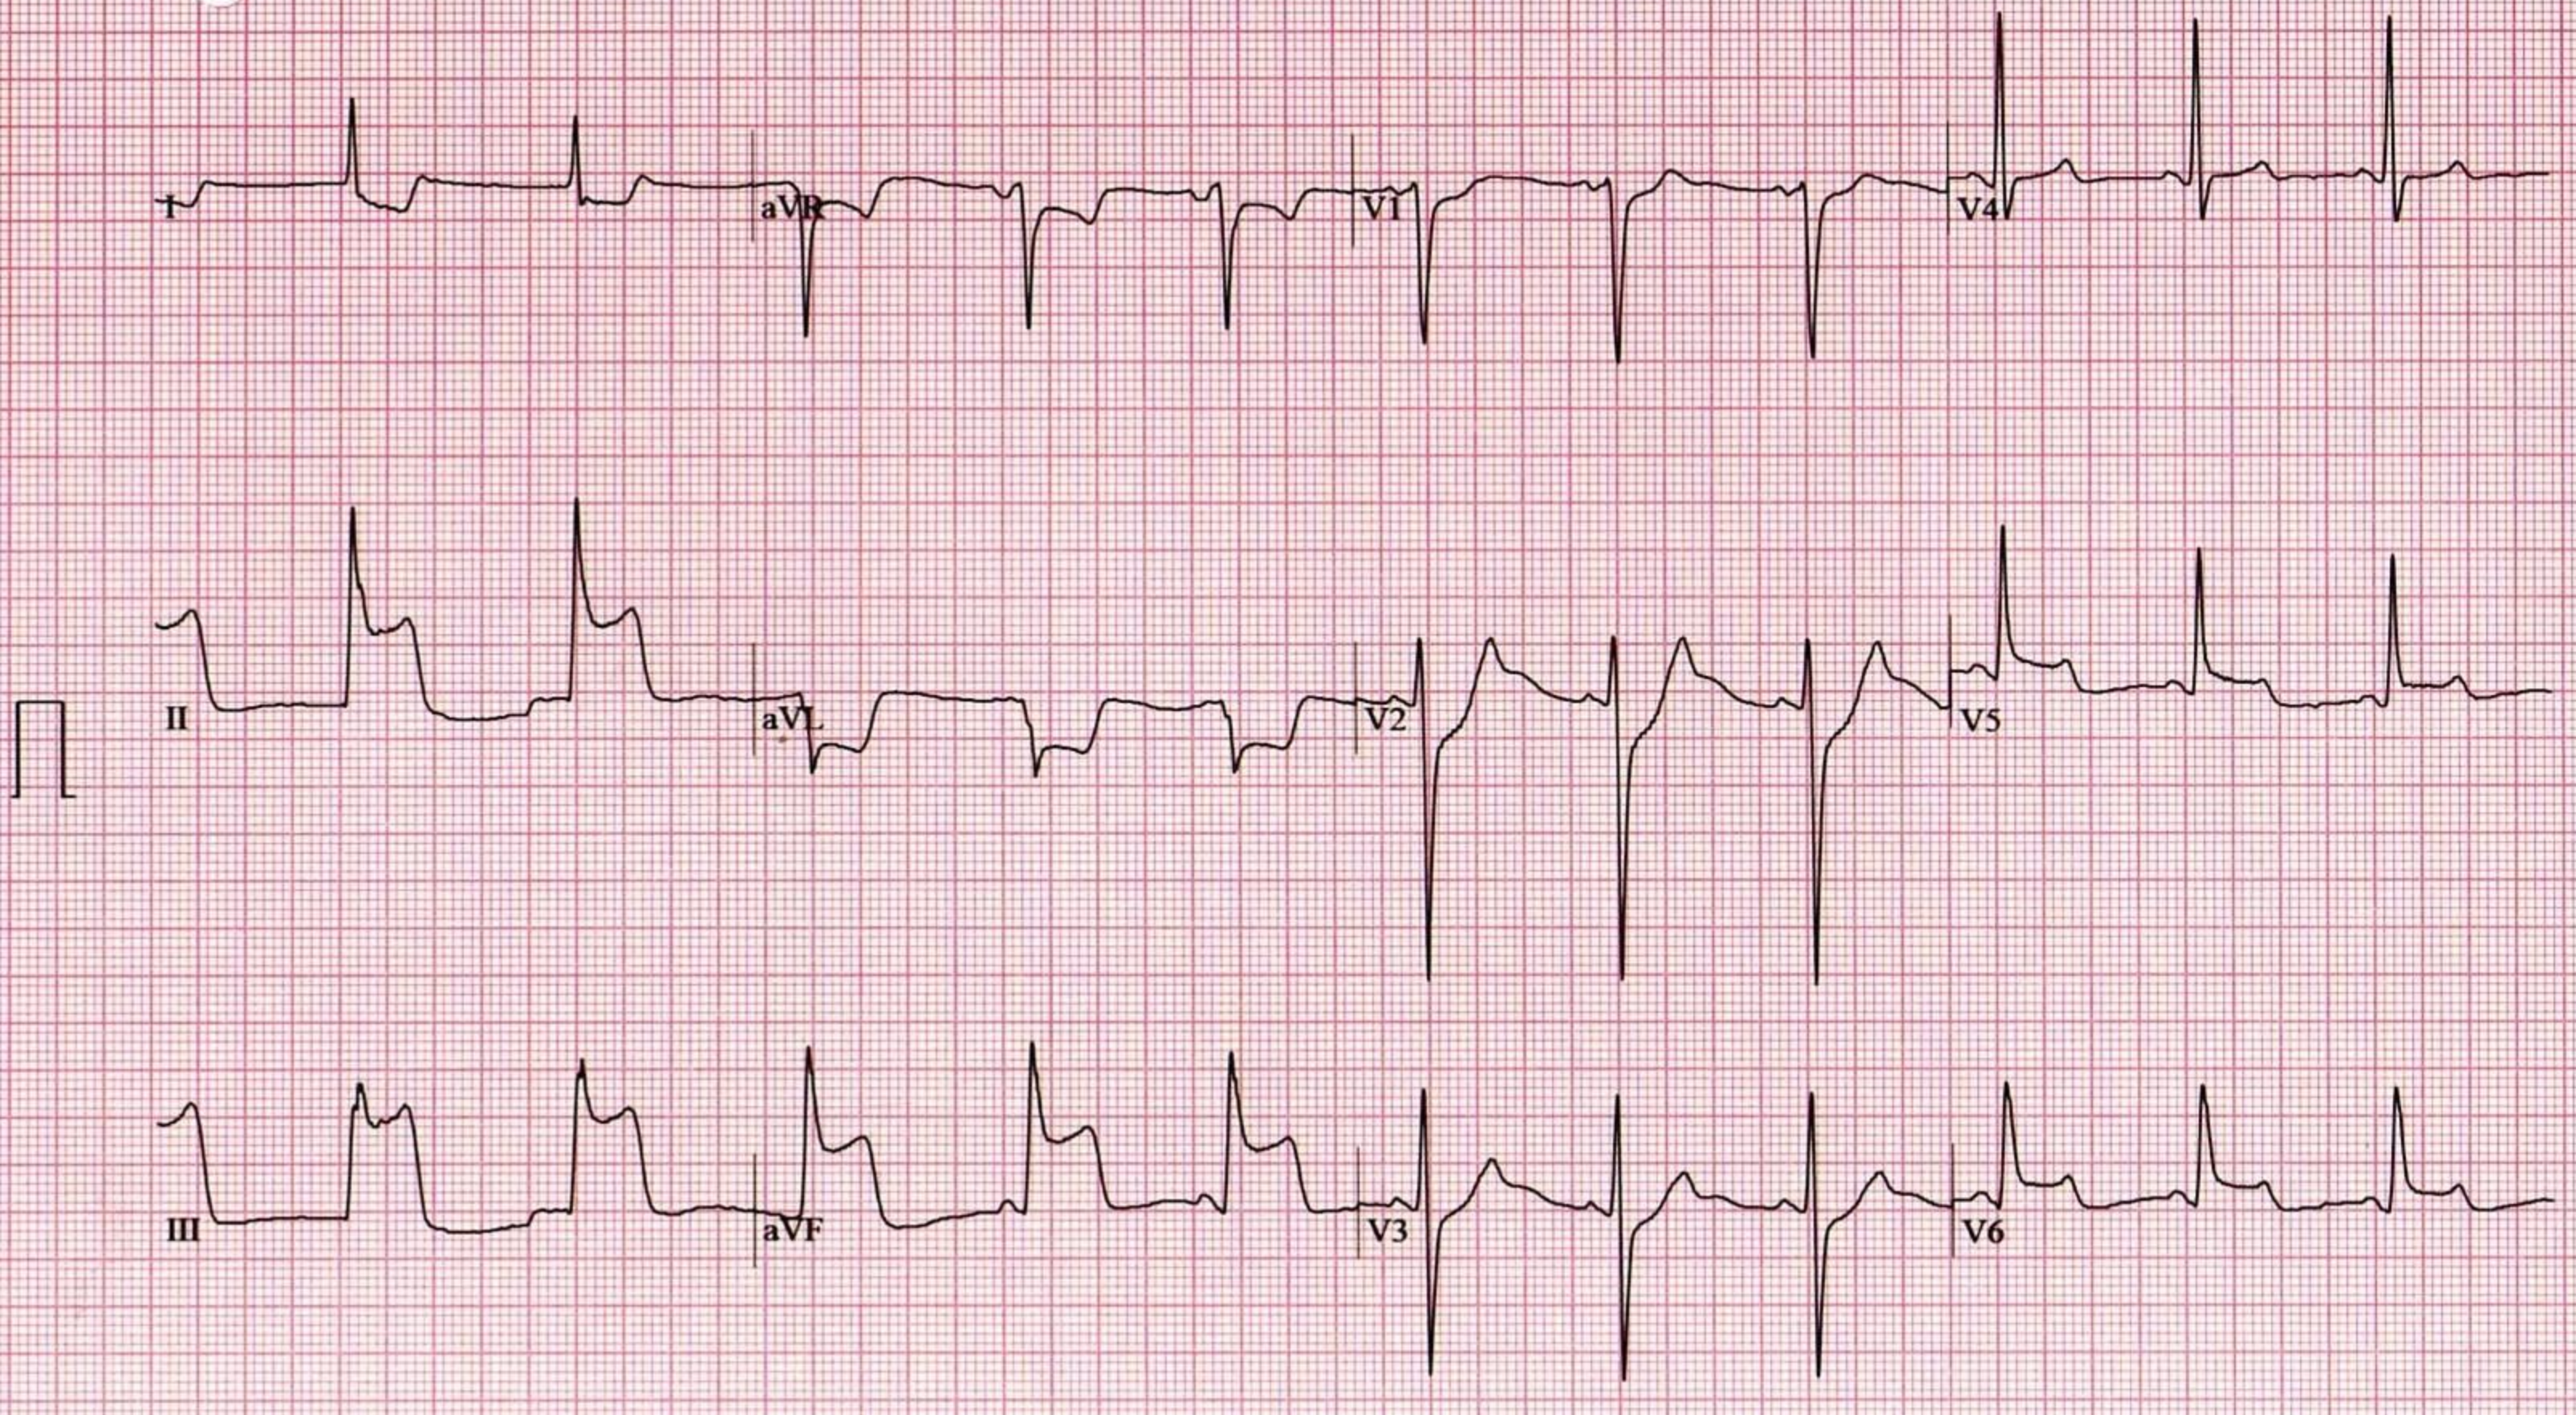

GE CASE V6.51 (0)
25mm/s 10mm/mV 50Hz 0.01Hz FRF+ FC(V1,V2)

No confirmado


Página 1

b

89 bpm
159/102 mmHg

RECUPER.
6:48

BRUCE
0.0 km/h
0.0%

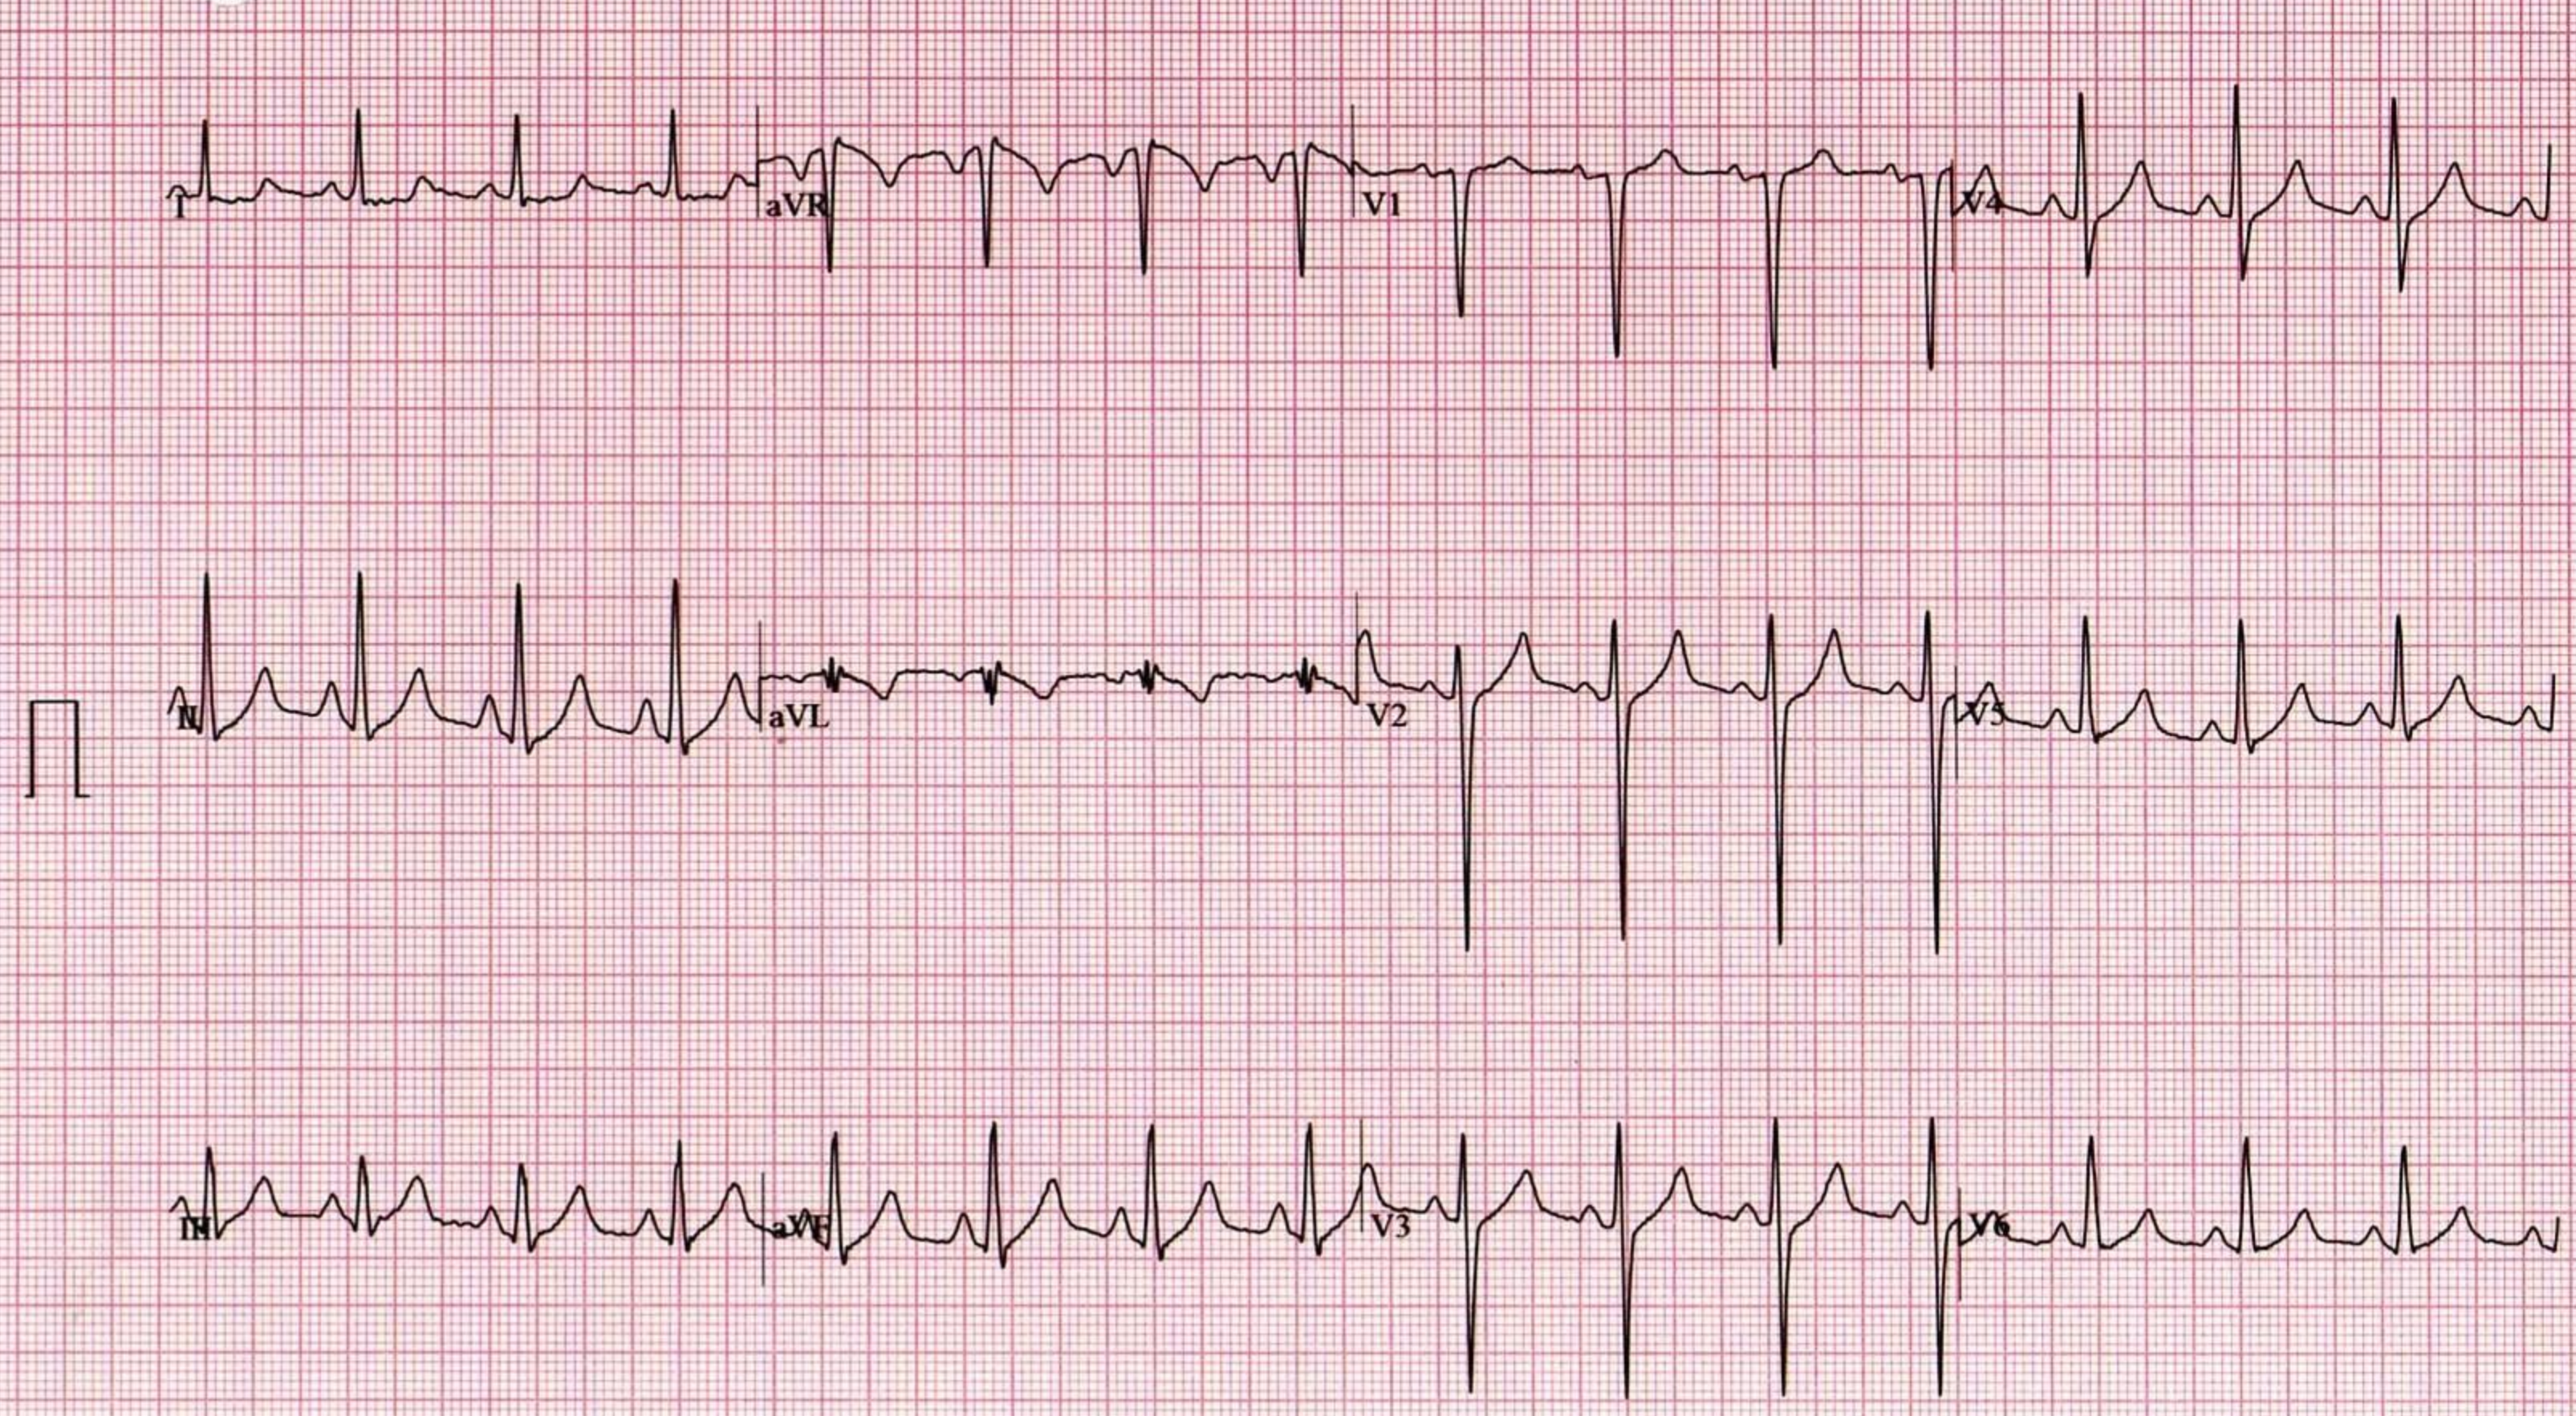

GE CASE V6.51 (0)
25mm/s 10mm/mV 50Hz 0.01Hz FRF+ FC(V1,V2)

No confirmado

Página 1

c